



PUBLIC UTILITIES REGULATORY COMMISSION (PURC)

Public Utilities Regulatory Information Systems (PURIS)

1st Quarter, 2019



- **Total Energy Transmitted(GWh):**
4,451.85
- **Max System Demand (MW):**
2,961.00
- **Average Demand (MW):**
2,038.39
- **Load Factor (%)**
76.59%

Number of Lines Outages

- Planned (#):
56
- Unplanned (#):
623

Automatic Load Shedding

- Number of Incidences (#):
50
- Total Duration (hh:mm):
138:42


Manual Load Shedding

- Number of Incidences (#):
192
- Total Duration (hh:mm):
405:47

SAIDI: System Average Interruption Duration Index

SAIFI: System Average Interruption Frequency Index

Performance Statistics

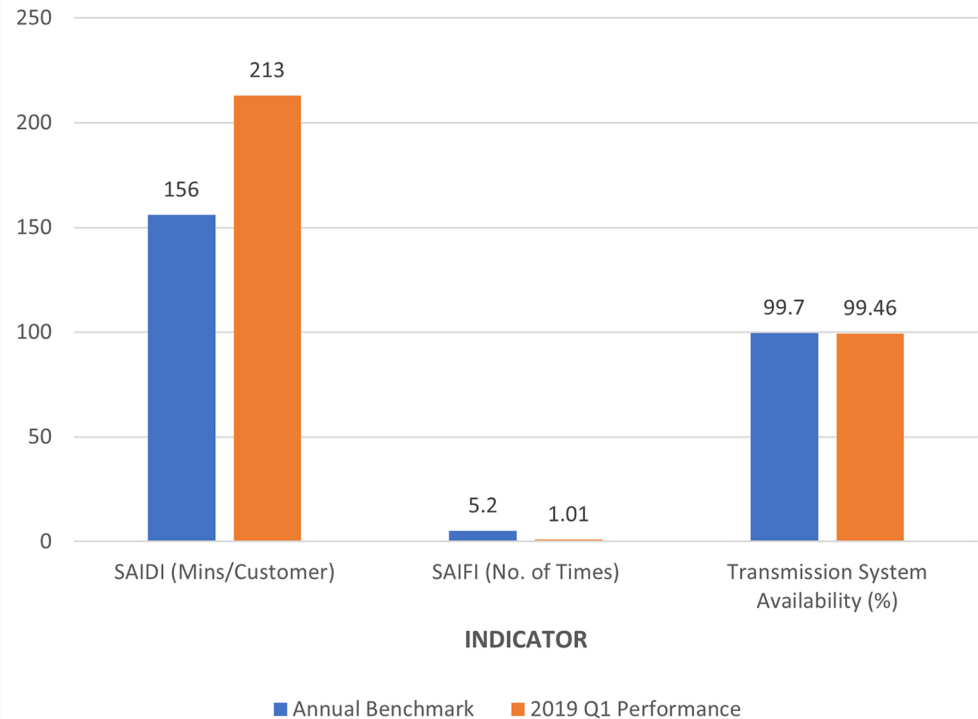

FREQUENCY DEVIATION

