



PUBLIC UTILITIES REGULATORY COMMISSION (PURC)

Public Utilities Regulatory Information Systems (PURIS)

2nd Quarter 2025



- Total Energy Transmitted(GWh): 6800.83
- Max System Demand (MW): 3741
- Average Demand (MW): 3080.1
- Load Factor (%): 76.16%

Number of Lines Outages

- Planned (#): 124
- Unplanned (#): 333

Automatic Load Shedding (AFLS)

- Number of incidence (#): 5
- Total Duration (hh:mm:ss): 06:56:00


Manual Load Shedding

- Number of Incidences (#): 79
- Total Duration (hh:mm:ss): 111:34:00

SAIDI: System Average Interruption Duration Index

SAIFI: System Average Interruption Frequency Index

Performance Statistics

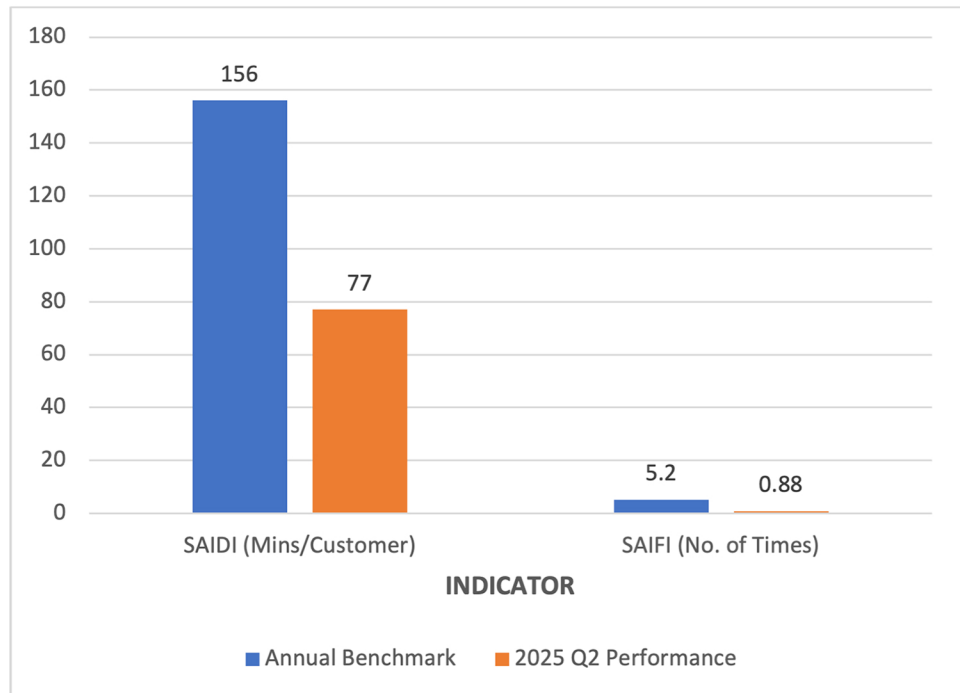

FREQUENCY DEVIATION

