



PUBLIC UTILITIES REGULATORY COMMISSION (PURC)

Public Utilities Regulatory Information Systems (PURIS)

1st Quarter, 2024



- **Total Energy Transmitted(GWh):**
6,316.70
- **Max System Demand (MW):**
3,556.00
- **Average Demand (MW):**
2,860.82
- **Load Factor (%)**
79.07%

Number of Lines Outages

- Planned (#):
76
- Unplanned (#):
278

Automatic Load Shedding (AFLS)

- Number of Incidences (#):
6
- Total Duration (hh:mm:ss):
6:23:00


Manual Load Shedding

- Number of Incidences (#):
363
- Total Duration (hh:mm:ss):
10:30:36:00

SAIDI: System Average Interruption Duration Index

SAIFI: System Average Interruption Frequency Index

Performance Statistics

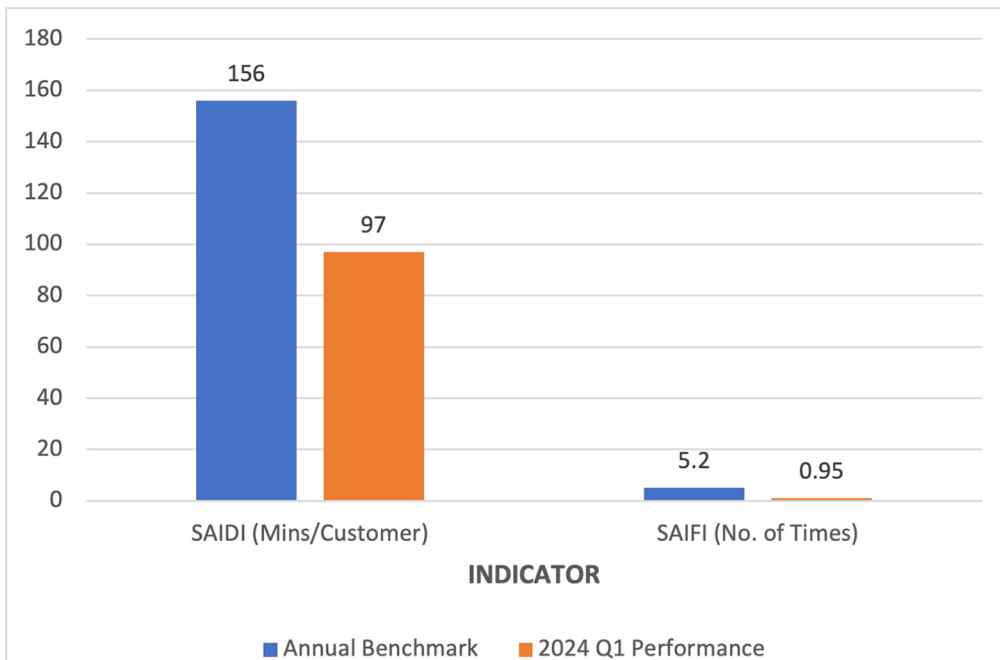

FREQUENCY DEVIATION

