



PUBLIC UTILITIES REGULATORY COMMISSION (PURC)

Public Utilities Regulatory Information Systems (PURIS)

3rd Quarter 2025



- Total Energy Transmitted(GWh): 6800
- Max System Demand (MW): 3900.00
- Average Demand (MW): 3080.08
- Load Factor (%): 75.62%

Number of Lines Outages

Planned (#): 34
Unplanned (#): 180

Automatic Load Shedding (AFLS)

Number of incidence (#): 5
Total Duration (hh:mm:ss): 6:56:00


Manual Load Shedding

Number of Incidences (#): 79
Total Duration (hh:mm:ss): 111:34:00

SAIDI: System Average Interruption Duration Index

SAIFI: System Average Interruption Frequency Index

Performance Statistics

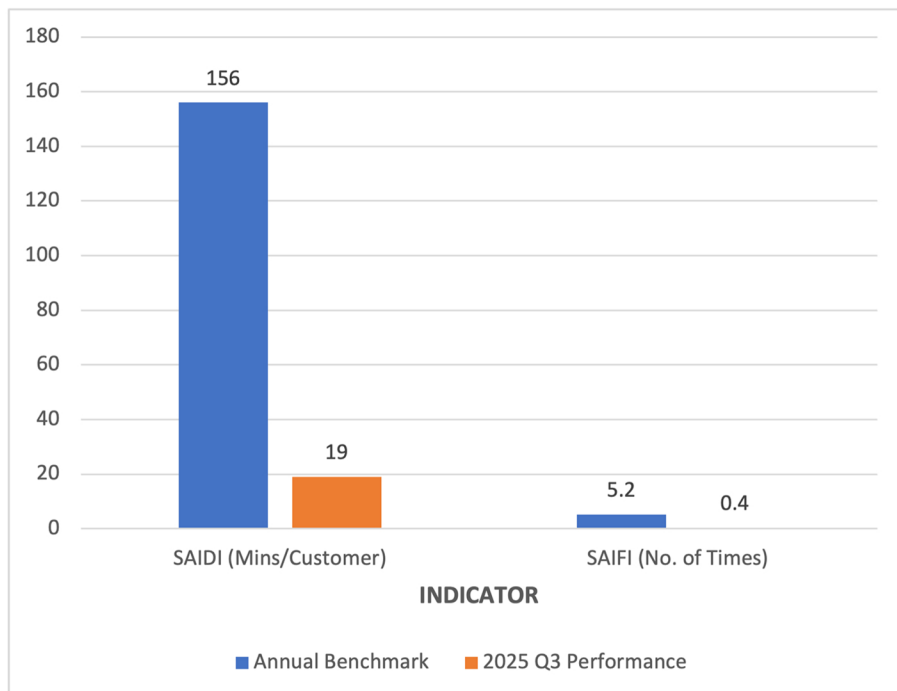

FREQUENCY DEVIATION

