



PUBLIC UTILITIES REGULATORY COMMISSION (PURC)

Public Utilities Regulatory Information Systems (PURIS)

3rd Quarter, 2022



- Total Energy Transmitted(GWh): 5,273.50
- Max System Demand (MW): 3,182.00
- Average Demand (MW): 2,388.36
- Load Factor (%): 75.06

Number of Lines Outages

- Planned (#): 95
- Unplanned (#): 186


Manual Load Shedding

- Number of Incidences (#): 31
- Total Duration (hh:mm): 15:43

SAIDI: System Average Interruption Duration Index

SAIFI: System Average Interruption Frequency Index

Performance Statistics

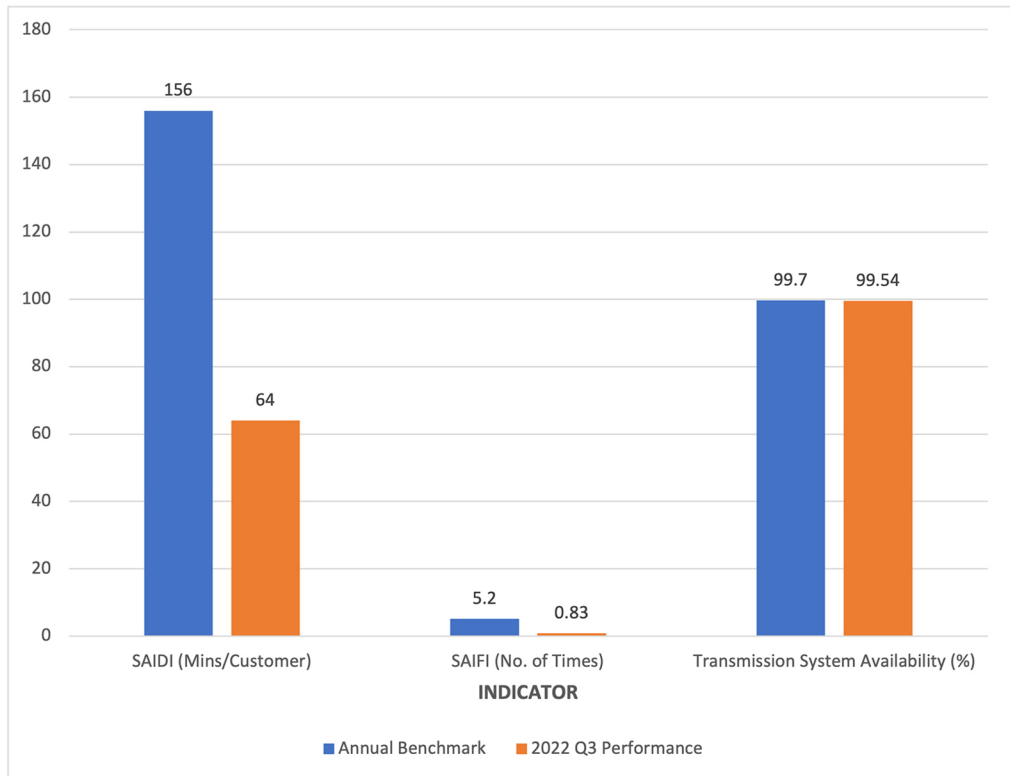

FREQUENCY DEVIATION

