



PUBLIC UTILITIES REGULATORY COMMISSION (PURC)

Public Utilities Regulatory Information Systems (PURIS)

3rd Quarter, 2023



- Total Energy Transmitted(GWh): 5586.98
- Max System Demand (MW): 3280.00
- Average Demand (MW): 2530.34
- Load Factor (%): 77.14%

Number of Lines Outages

- Planned (#): 96
- Unplanned (#): 271

Automatic Load Shedding (AFLS)

- Number of Incidences (#): 2
- Total Duration (hh:mm:ss): 09:01


Manual Load Shedding

- Number of Incidences (#): 71
- Total Duration (hh:mm:ss): 139:35:00

SAIDI: System Average Interruption Duration Index

SAIFI: System Average Interruption Frequency Index

Performance Statistics

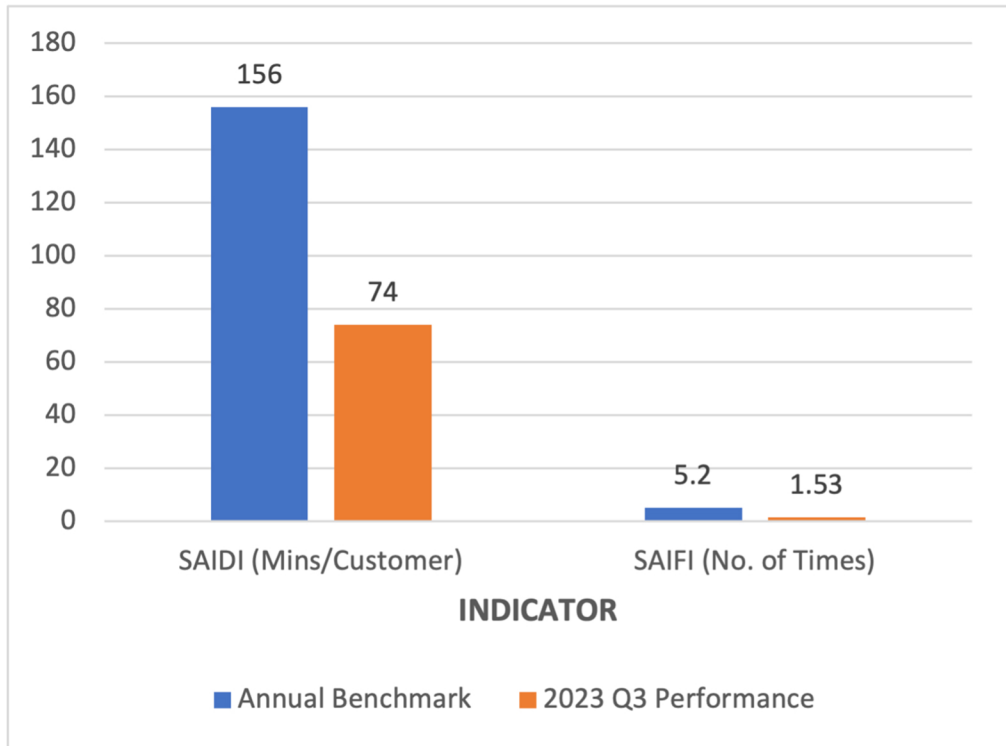

FREQUENCY DEVIATION

