



PUBLIC UTILITIES REGULATORY COMMISSION (PURC)

Public Utilities Regulatory Information Systems (PURIS)

2nd Quarter, 2020



- **Total Energy Transmitted(GWh):**
4,902.18
- **Max System Demand (MW):**
2,951.00
- **Average Demand (MW):**
2,244.59
- **Load Factor (%)**
76.06%

Number of Lines Outages

- Planned (#):
88
- Unplanned (#):
319

Automatic Load Shedding

- Number of Incidences (#):
7
- Total Duration (hh:mm):
7:45


Manual Load Shedding

- Number of Incidences (#):
63
- Total Duration (hh:mm):
35:36

SAIDI: System Average Interruption Duration Index

SAIFI: System Average Interruption Frequency Index

Performance Statistics

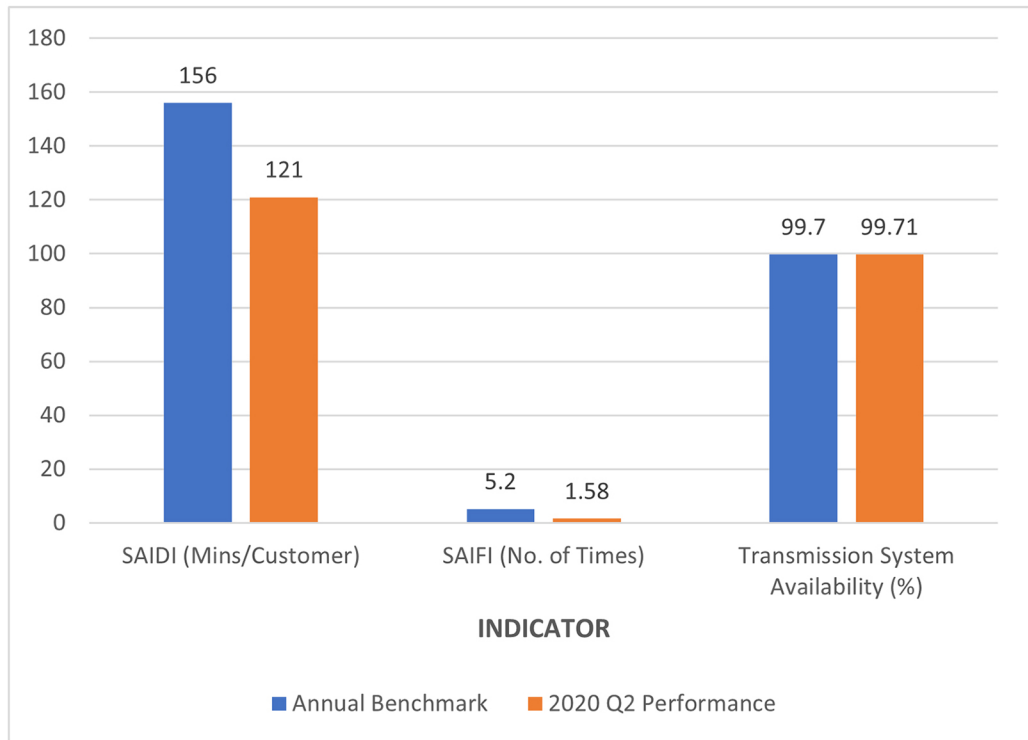

FREQUENCY DEVIATION

