



PUBLIC UTILITIES REGULATORY COMMISSION (PURC)

Public Utilities Regulatory Information Systems (PURIS)

2nd Quarter, 2024



- Total Energy Transmitted(GWh): 5,938.24
- Max System Demand (MW): 3,553.00
- Average Demand (MW): 2,689.42
- Load Factor (%): 74.33%

Number of Lines Outages

- Planned (#): 130
- Unplanned (#): 268

Automatic Load Shedding (AFLS)

- Number of Incidences (#): 19
- Total Duration (hh:mm:ss): 27:24:00


Manual Load Shedding

- Number of Incidences (#): 202
- Total Duration (hh:mm:ss): 586:48:00

SAIDI: System Average Interruption Duration Index

SAIFI: System Average Interruption Frequency Index

Performance Statistics

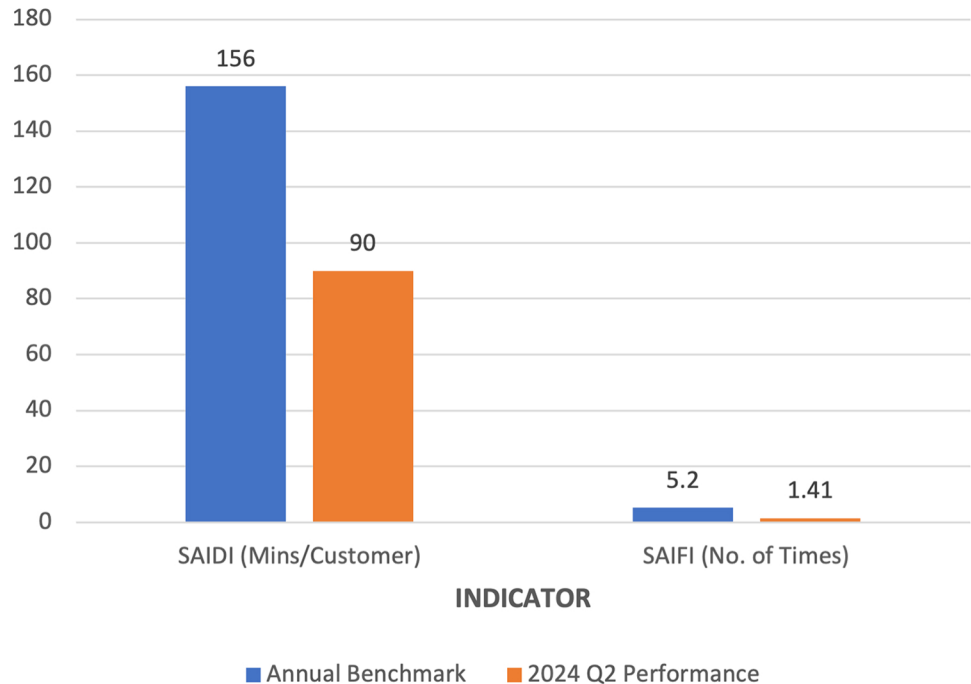

FREQUENCY DEVIATION

